


1117 Ratio of lead service lines (%)

Ratio of lead service lines = Number of lead service lines in use [case]
/ Number of service lines [case] x 100 (%)

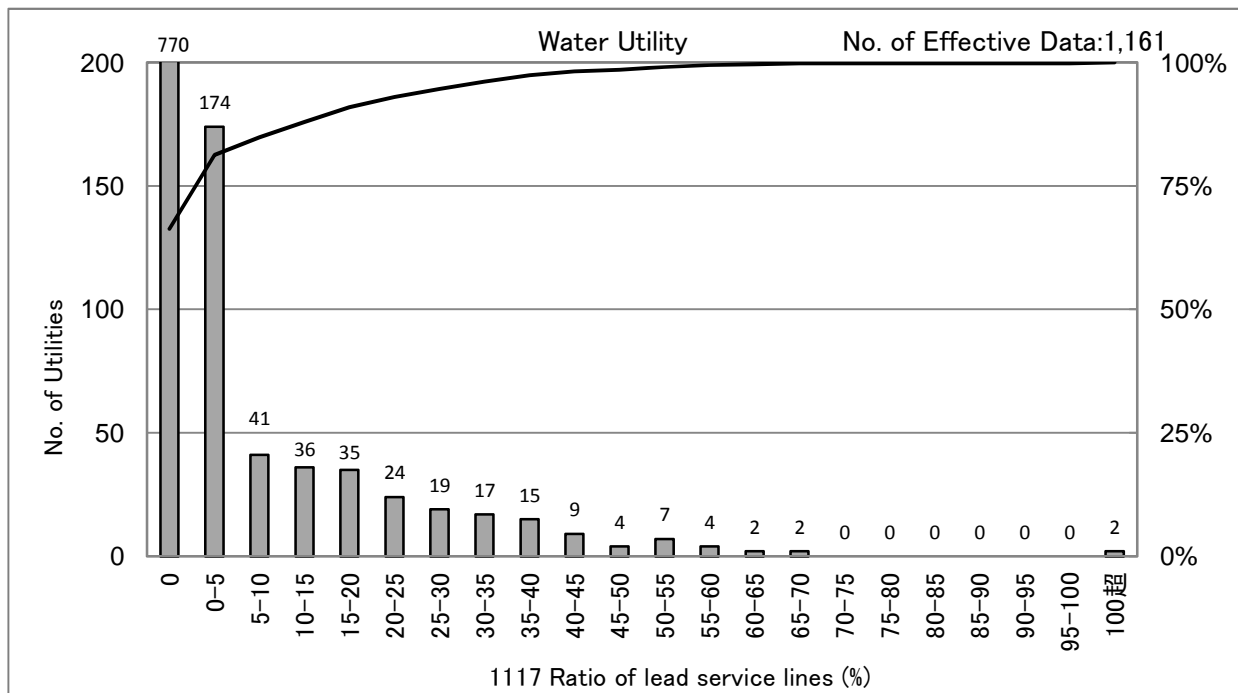

[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	36.4	3.2	0.0	0.0	0.0
2009	34.8	2.6	0.0	0.0	0.0
2010	33.6	2.1	0.0	0.0	0.0
2011	32.2	1.9	0.0	0.0	0.0
2012	31.6	1.7	0.0	0.0	0.0

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	9.4	0.0	0.0	0.0	0.0
1-3	18.7	0.0	0.0	0.0	0.0
3-10	32.1	3.9	0.0	0.0	0.0
10-50	41.6	18.6	2.2	0.0	0.0
50<	27.9	16.2	6.3	1.2	0.0

× 10,000people

[Scatter Plot]

