


# 4002 Energy consumption per 1m<sup>3</sup> transmission input (MJ/m<sup>3</sup>)

Energy consumption per 1m<sup>3</sup> transmission input = Total energy consumption[MJ]  
/ Annual transmission input[m<sup>3</sup>] (MJ/m<sup>3</sup>)

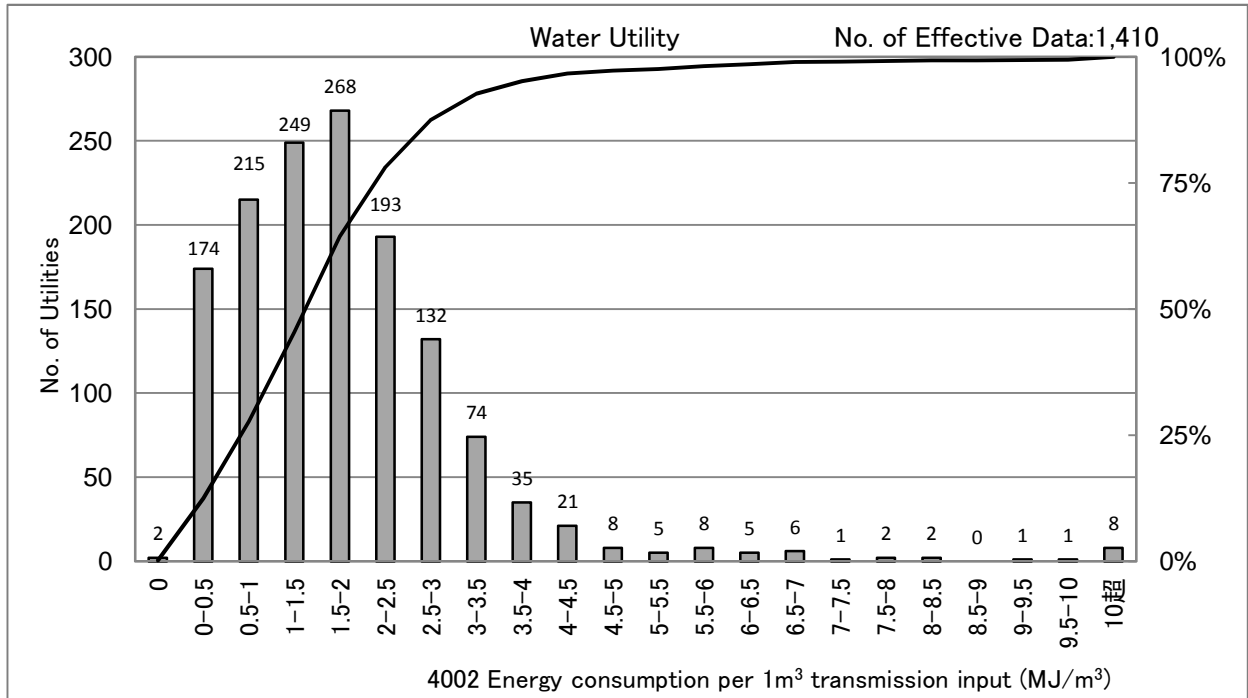

## [Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	3.67	2.34	1.63	0.91	0.20
2009	3.77	2.34	1.63	0.89	0.19
2010	3.71	2.38	1.62	0.91	0.20
2011	3.83	2.36	1.59	0.90	0.20
2012	3.92	2.38	1.61	0.91	0.20

## Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	6.36	3.09	2.06	1.10	0.19
1-3	3.57	2.60	1.76	0.91	0.17
3-10	2.99	2.06	1.54	0.98	0.26
10-50	2.31	1.65	1.15	0.79	0.21
50<	2.03	1.51	1.07	0.58	0.40

× 10,000people

## [Scatter Plot]

