


5107 Leakage rate (%)

Leakage rate = Annual leakage[m³] / Annual transmission input[m³] x 100 (%)

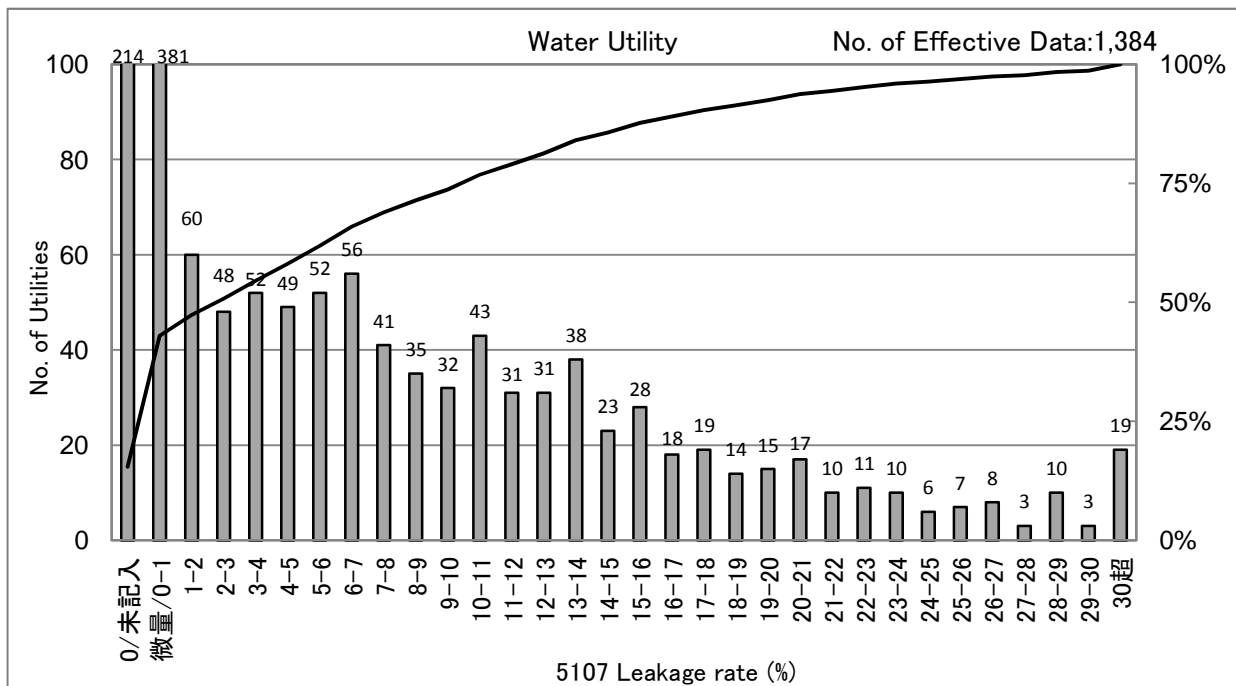

[Percentile Value] Water Utility
Fiscal year


F.Y.	95%	75%	50%	25%	5%
2008	21.0	8.9	1.2	0.0	0.0
2009	20.5	8.9	1.6	0.0	0.0
2010	20.4	9.7	2.1	0.0	0.0
2011	23.0	10.4	2.8	0.0	0.0
2012	22.6	10.3	2.8	0.0	0.0

"Small" in "Small/0-1" means that grasp of the quantity of leakage water is not possible. Or there is entered the quantity of found leakage water. Next chart shows the leakage rate greater than 2%.

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	28.4	13.6	0.8	0.0	0.0
1-3	23.0	12.8	2.6	0.0	0.0
3-10	17.1	9.2	2.9	0.0	0.0
10-50	13.3	7.1	3.7	0.9	0.0
50<	7.4	6.1	4.7	2.6	0.4

x 10,000people

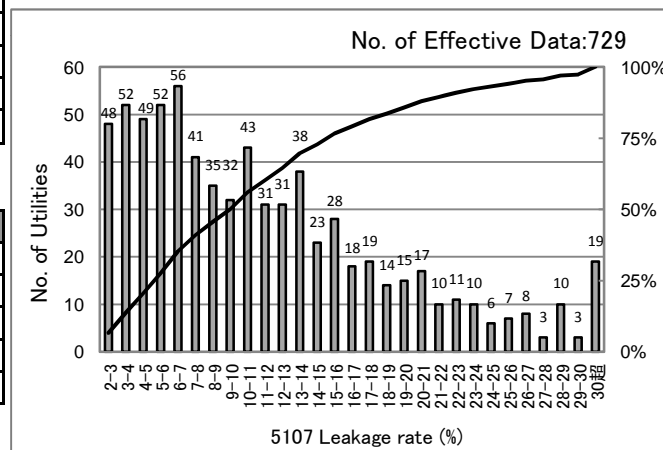

[Scatter Plot]

