


1114A Compliance for disinfection by-products (%)

Compliance for disinfection by-products (include Chloric acid) = \sum (Maximum concentration of each disinfection by-product / Target concentration of each disinfection by-product) / 6 x 100 (%)

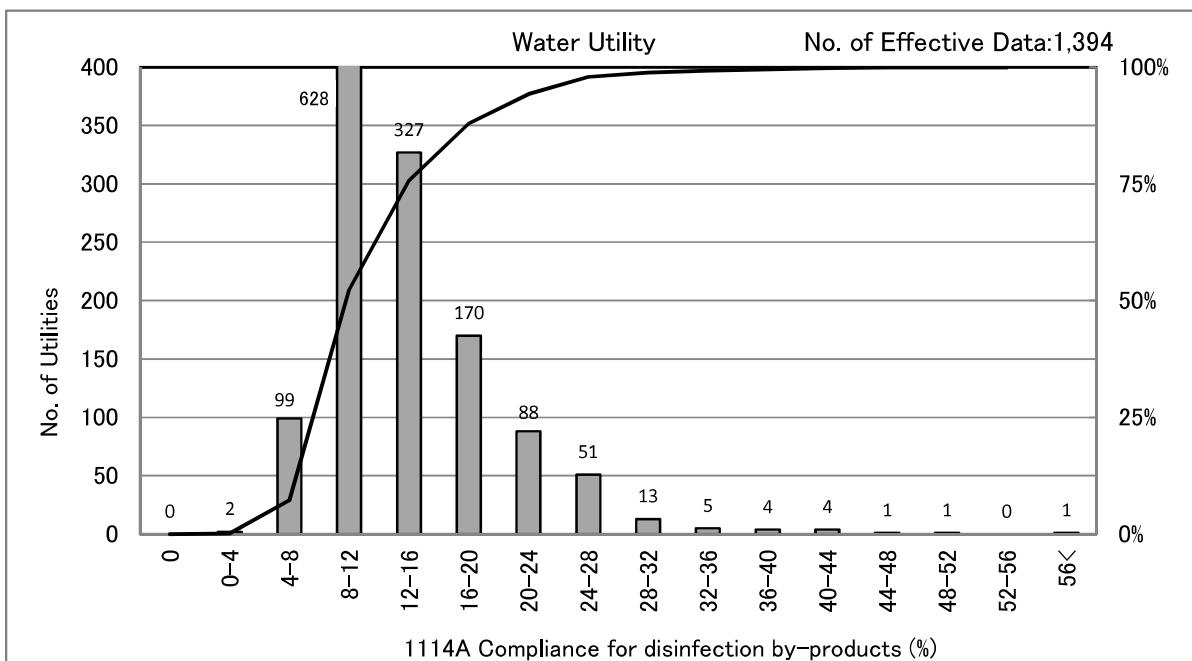

[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2009	25	16	12	10	8
2010	19	12	10	10	6
2011	20	12	10	10	7
2012	19	12	10	10	6
2013	25	16	12	10	8

Disinfection By-Products	Water Quality Std.
Bromic acid	0.01mg/L
Chloroacetic acid	0.02mg/L
Dichloroacetic acid	0.04mg/L
Trichloroacetic acid	0.2mg/L
Formaldehyde	0.08mg/L
Chloric acid	0.6mg/L

Population supplied (F.Y.2013)

Persons	95%	75%	50%	25%	5%
<=1	25	14	11	10	7
1-3	23	15	12	10	8
3-10	26	17	12	10	8
10-50	22	16	13	11	9
50<	19	16	11	10	8

× 10,000persons

* Chloric acid was added to the water quality standards on April 1, 2008.

[Scatter Plot]

