



2104 Mains rehabilitation (%)

Mains rehabilitation = Length of replaced pipelines[km]
/ Total pipeline length[km] x 100 (%)

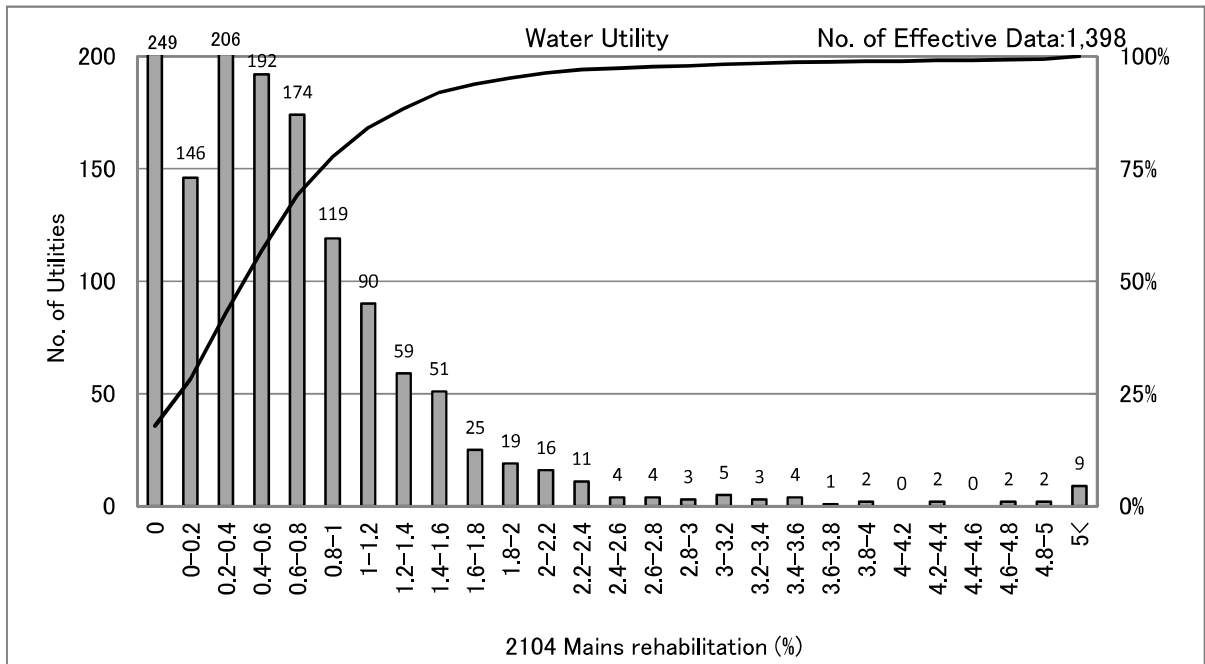

[Percentile Value] Water Utility
Fiscal year

| F.Y. | 95% | 75% | 50% | 25% | 5% |
|------|------|------|------|------|------|
| 2009 | 2.36 | 1.16 | 0.57 | 0.10 | 0.00 |
| 2010 | 2.09 | 1.05 | 0.58 | 0.11 | 0.00 |
| 2011 | 1.98 | 1.00 | 0.52 | 0.11 | 0.00 |
| 2012 | 1.87 | 0.94 | 0.50 | 0.12 | 0.00 |
| 2013 | 1.92 | 0.93 | 0.50 | 0.15 | 0.00 |

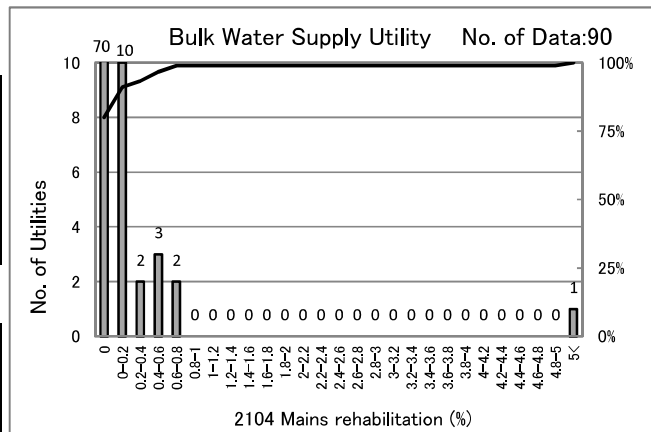

Population supplied (F.Y.2013)

| Persons | 95% | 75% | 50% | 25% | 5% |
|---------|------|------|------|------|------|
| <=1 | 2.32 | 0.64 | 0.16 | 0.00 | 0.00 |
| 1-3 | 2.30 | 0.98 | 0.44 | 0.11 | 0.00 |
| 3-10 | 1.69 | 0.90 | 0.58 | 0.31 | 0.00 |
| 10-50 | 1.63 | 1.09 | 0.74 | 0.46 | 0.18 |
| 50< | 1.52 | 1.18 | 0.80 | 0.55 | 0.05 |

x 10,000persons

| [Percentile Value] | F.Y. | 95% | 75% | 50% | 25% | 5% |
|--------------------|------|-----|-----|-----|-----|-----|
| 2010 | 0.3 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 2011 | 0.5 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 2012 | 0.7 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 2013 | 0.4 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

[Scatter Plot]

