

Water Utility Information (FY 2014)



Basics		Name of utility:		Public Enterprises Agency Kanagawa Prefectural Government		Service type:		Water service provider			
		Administrative population:		3.03 million people		Start of service:		1933			
		Population served:		2.8 million people		Service area:		808.59 km ²			
Water supply volume											
		Average daily water supply:		880,000 m ³ /d		Break down		Household use		664,000 m ³ /d	
								Commercial and Industrial use:		152,000 m ³ /d	
								Others:		42,000 m ³ /d	
								From wholesale supplier		25,000 m ³ /d	
		Average daily water supply per capita:		292.6 L/person/d	Service coverage:		99.8 %				
		Effectiveness:		92.7 %	Revenue water:		88.5 %				
		NRW:		11.5 %	Water loss		6.7 %				
Water rates											
		Water rate for 10m ³ /month:		1,043 yen (including taxes)							
				**Calculation condition: The fixed charge is 1,420 yen/two months. The volumetric charge is 128 yen/m ³ from 17 to 30 m ³ = 1,932 yen x taxes x 1/2							
		Water production cost:		164.14 yen/m ³	Water supply cost:		156.01 yen/m ³				
Facilities		Water Treatment Plant and Facilities (including water from wholesale supplier):		Name		Capacity		Water source		Treatment process	
				Samukawa WTP		750,000 m ³ /d		Surface water		Coagulation/sedimentation + Rapid filtration + Chlorine disinfection	
				Tanigahara WTP		242,800 m ³ /d		Subsoil water Surface water		Sedimentation + Slow filtration + Chlorine disinfection Coagulation/sedimentation + Rapid filtration + Chlorine disinfection	
				Kamasawa WTP		720 m ³ /d		Surface water		Membrane filtration + Chlorine disinfection	
				Ochiai WTP		1,620 m ³ /d		Surface water		Membrane filtration + Chlorine disinfection	
				Wada WTP		360 m ³ /d		Surface water		Membrane filtration + Chlorine disinfection	
				Oyama WTP		1,100 m ³ /d		Surface water		Membrane filtration + Chlorine disinfection	
				Sokozawa WTP		470 m ³ /d		Surface water		Membrane filtration + Chlorine disinfection	
		Toya WTP		5,550 m ³ /d		Subsoil water		Coagulation/sedimentation + Rapid filtration + Chlorine disinfection			

		Nagano WTP	500 m ³ /d	Subsoil water	Membrane filtration + Chlorine disinfection
		Itarih WTP	4,400 m ³ /d	Spring water	Membrane filtration + Chlorine disinfection
		Shinanoki WTP	3,300 m ³ /d	Spring water	Membrane filtration + Chlorine disinfection
		Midono water source	12,800 m ³ /d	Spring water	UV treatment + Chlorine disinfection
		Others (Kissawa etc)	1,700 m ³ /d	Ground water	Chlorine disinfection
		Water from wholesale supplier	669,400 m ³ /d	–	–
		Total	1,694,720 m ³ /d		
Pipes	Pipeline length:	9,217 km	Conveyance: 12 km	Transmission: 221 km	
			Distribution: 8,984 km	Others: – km	
	Type of material:	<ul style="list-style-type: none"> •Cast iron: 6,381km •Steel: 481km •Stainless: 14km 			
Others	Other information:	<ul style="list-style-type: none"> •Number of employees: 623 •Seismic reinforcement rate of pumping stations: 4.8% •Seismic reinforcement rate of distribution reservoirs: 21.6% •Maximum daily supply: 1.04 million m³/day •Maximum facility utilization rate: 68.5% (Maximum daily supply/treatment capacity) •Facility utilization rate: 62.9% (Average daily water supply/treatment capacity) 			
	Remarks:	<ul style="list-style-type: none"> •The information in the Basics, Facilities and Pipes sections (except for the pipeline length, pipe material and ratio of lead service pipe) was cited from the Annual Statistics Report FY2014 of the Kanagawa Prefectural Government. http://www.pref.kanagawa.jp/uploaded/attachment/801189.pdf •The pipeline length and pipe material is based on the registry of the fixed assets of the Kanagawa Prefectural Government. •The information on the lead service pipe and the seismic reinforcement ratio (except for the one of primary mains) was cited from the PI guidelines for water supply services FY2014. http://www.pref.kanagawa.jp/uploaded/life/1005094_3294728_misc.pdf •The seismic reinforcement ratio of primary mains is based on the reference material below. http://www.pref.kanagawa.jp/uploaded/attachment/832973.pdf 			

Water Utility Information (FY 2014)

S
e
r
v
i
c
e


a
r
e
a

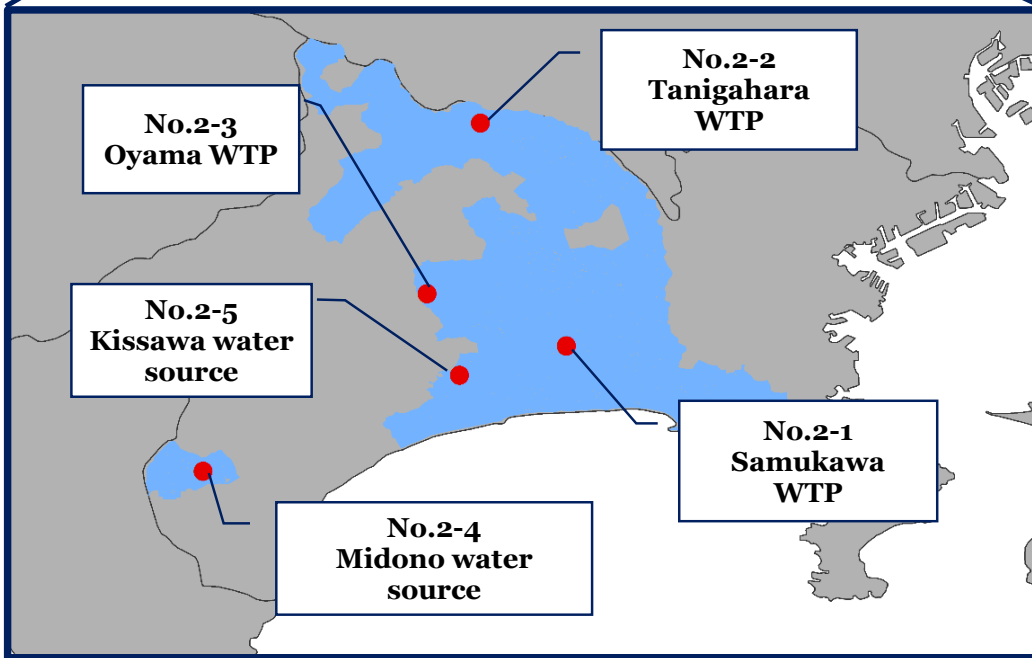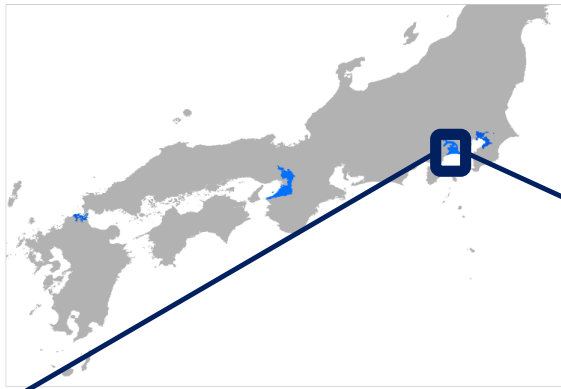

Service area

● Case study facility

Overview of facilities

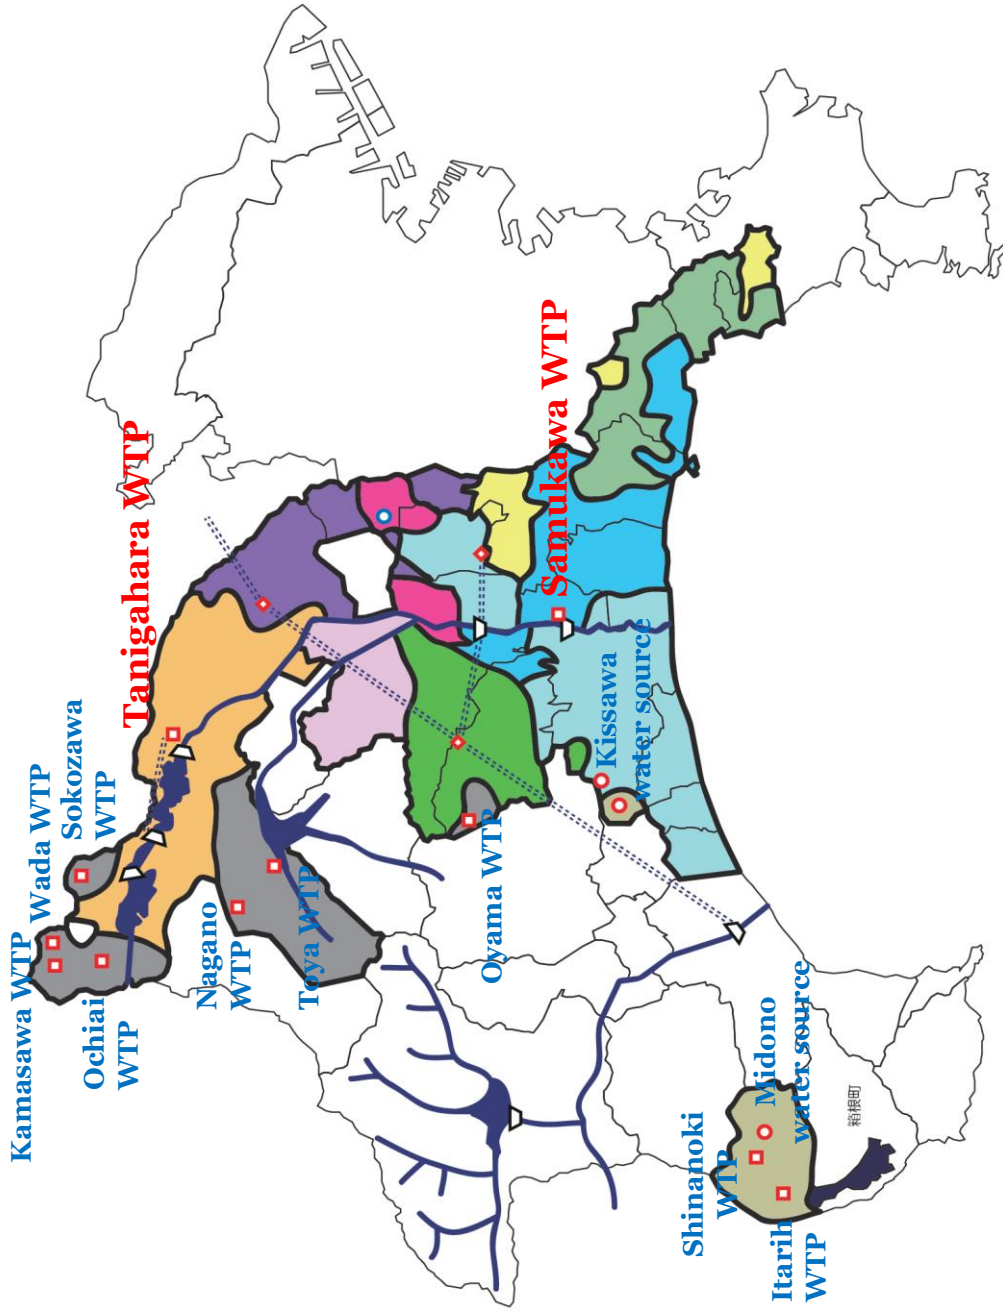

Case Study Report (Samukawa Water Treatment Plant)

Water treatment process


Case #2-1	Samukawa Water Treatment Plant
Key word:	Surface water (river), Rapid filtration
Outline:	<p><Characteristics></p> <ul style="list-style-type: none"> ● Features of the Samukawa Water Treatment Plant • Reliable water supply: The Samukawa Water Treatment Plant has a distribution management system to monitor and control reservoirs and pumping stations in the utility's distribution network. On the premises there are two water treatment plants called No. 2 and No 3 WTPs (No. 1 WTP has been demolished). These two plants are responsible for an efficient and reliable distribution management based on demand forecasts as well as for mutual water transfers with other utilities. • Environmental measures: Solar power generation system. Surplus soil from on-site excavations is recycled as raw materials of cement additives. • Private sector involvement: A Private Finance Initiative (PFI) has been used for the construction and operation of the drainage facility. <p><Outline></p> <ul style="list-style-type: none"> • The Samukawa Water Treatment Plant is situated in the Samukawa Town approximately 6.5 km upstream from the estuary of the Sagami River. The Samukawa intake weir located in the town abstracts water from the river. The water treatment process consists of a coagulation/sedimentation, filtration and disinfection. • Service area: 11 Cities and 4 Towns • Capacity: 750,000 m³/d (No. 2 WTP: 210,000 m³/d + No. 3 WTP: 540,000 m³/d)
Address:	Miyagawa 4271, Samukawa Town, Kanagawa Prefecture
Land area:	487,229m ²
Water treatment process:	Coagulation/sedimentation + Rapid filtration + Chlorine disinfection
Capacity	750,000 m ³ /d
Water source:	Surface water (Sagami River)
Raw water quality:	<p>■ Since the raw water is taken from downstream of the Sagami River, it tends to be adversely affected by phytoplankton growth and artificial contaminations in upstream river bodies and lakes.</p> <p><Average raw water quality in FY2014 (maximum)></p> <ul style="list-style-type: none"> • Turbidity: 9.1 degrees (51 degrees) • Hardness: 59 mg/L (68mg/L) • TOC: 0.8 mg/L (1.3 mg/L) • pH: 7.8 (7.9) • Color: 3.4 degrees (12 degrees) • Geosmin: 0.002μg/L (0.004μg/L) • 2-MIB: <0.002 μg/L (0.007 μg/L) • TON: 8 (17)
Chemical dose	Sulfuric acid (pH adjustment), Sodium hydroxide (alkalinity adjustment), Polyaluminum chloride (coagulation), Sodium hypochlorite (disinfection)
Start of operation:	Dec-63

Case Study Report (Samukawa Water Treatment Plant)

Water treatment process

Layout:

● Arial view

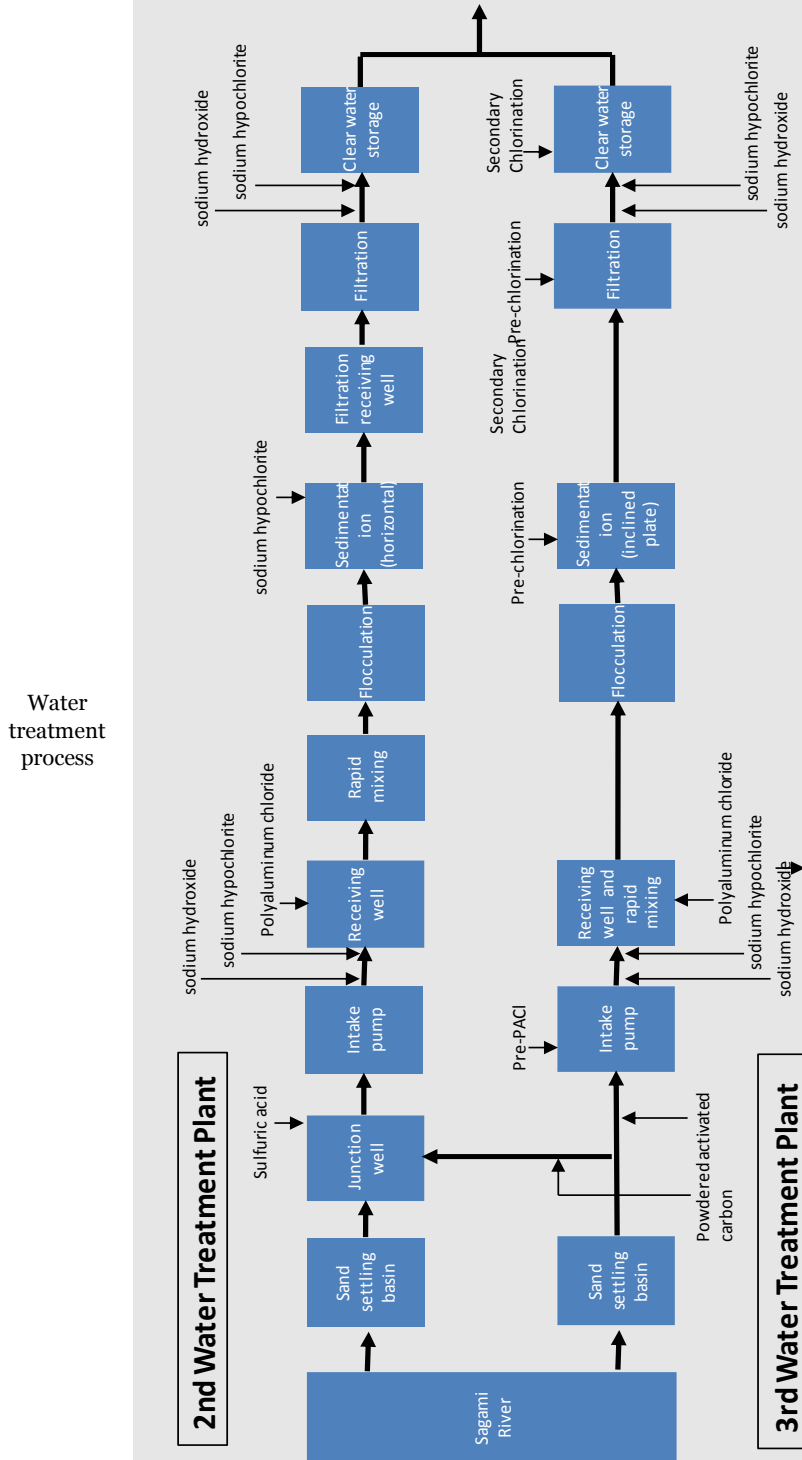

Case Study Report (Samukawa Water Treatment Plant)

Water treatment process

Pictures:

● Intake point



● Sand settling basin



● Flocculation basin



● Sedimentation basin



● Rapid filtration basin



Other facilities:

- Solar Power Generation System for CO₂ reduction
Maximum output: 120 kw (daily output varies depending on the weather)
Installation: Feb 2005
Location: on the top cover of filtration basins



- Backup Power Supply System
The backup power supply system enables the No. 2 and No. 3 water treatment plants to continue operation when a blackout cuts the commercial power supply from the Tokyo Electric Power Company.

Other information

- The Brochure of the Samukawa Water Treatment Plant (June 2015)
- The Water Quality Report of the Kanawaga Prefectural Government's Water Supply Service (Jan 2016)

Case Study Report (Tanigahara Water Treatment Plant)

Water treatment process

Case #2-2	Tanigahara Water Treatment Plant
Key word:	Surface water (lake), Slow filtration
Outline:	<p><Characteristics></p> <ul style="list-style-type: none"> • Efficient and Reliable water supply: The Tanigahara Water Treatment Plant has a monitoring and control system for not only on-site facilities but outside reservoirs and pumping stations of the utility's distribution network, providing an efficient and reliable water supply. To improve the treated water quality, automated feeders of activated carbon were installed in 2010. • Multiple water treatment processes: the plant has two trains of water treatment processes with the one using slow filtration and the other rapid filtration. The latter has three types of sedimentation methods: horizontal, inclined plate, and rapid ones. • Environmental measures: Surplus soil from on-site excavations is recycled as raw materials of cement additives <p><Outline></p> <ul style="list-style-type: none"> • Built in 1942 to address a rapid increase in water demand in the Sagami Region. • Service area: 2 Cities and 1 Town • Capacity: 242,800 m³/d (slow filtration system: 32,800 m³/d + rapid filtration system: 210,000 m³/d)
Address:	Tanigahara 2-6-1, Midori-ku, Sagami City, Kanagawa Prefecture
Land area:	91,492m ²
Water treatment process:	1. Slow filtration system: Sedimentation + Slow filtration + Chlorine disinfection 2. Rapid filtration system: Coagulation/sedimentation + Rapid filtration + Chlorine disinfection
Capacity	242,800 m ³ /d
Water source:	Surface water, Subsoil water (Sagami River)
Raw water quality:	<ul style="list-style-type: none"> ■ Mostly abstracted from the Sagami Lake, the raw water tends to contain a range of phytoplanktons including synedra (clogging filtration basin), microcystis (affecting filtrate turbidity) and anabaena (musty odor). <p><Average raw water quality in FY2014 (maximum)></p> <ul style="list-style-type: none"> • Turbidity: 7.6 degrees (35 degrees) • Hardness: 53 mg/L (61 mg/L) • TOC: 0.8 mg/L (1.3 mg/L) • pH: 7.8 (8.5) • Color: 6 degrees (22 degrees) • Geosmin: 0.003μg/L (0.008μg/L) • 2-MIB: <0.001 μg/L (0.002 μg/L) • TON: 3 (5)
Chemical dose:	Sulfuric acid (pH adjustment), Calcium hydroxide (alkalinity adjustment), Polyaluminum chloride (coagulation), Sodium hypochlorite (disinfection)
Start of operation	Mar-40

Case Study Report (Tanigahara Water Treatment Plant)



Water treatment process

Layout

● Arial view



Water treatment process flow

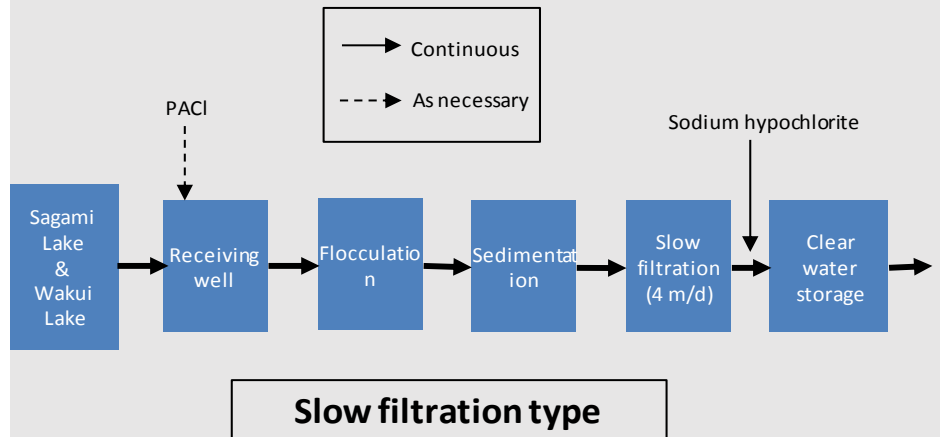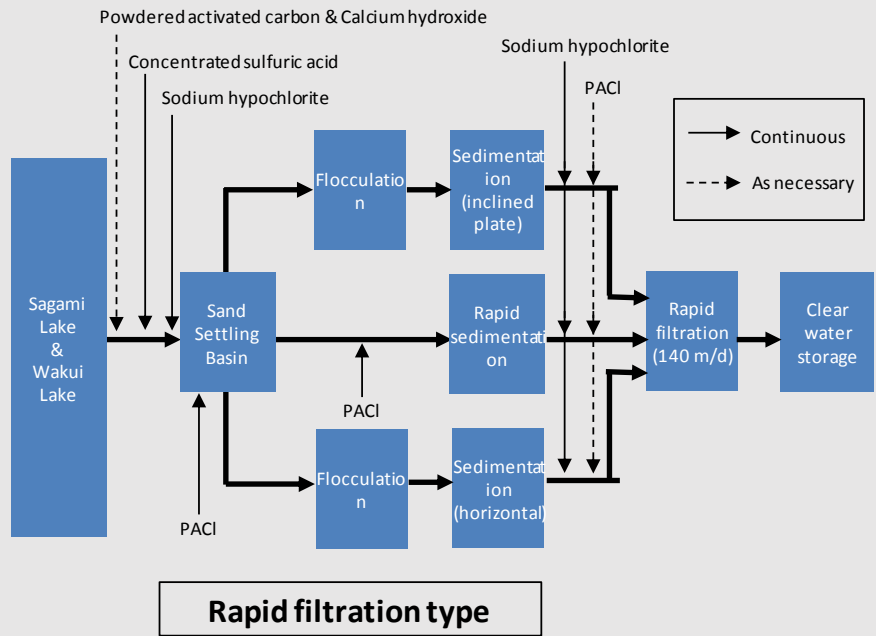

Case Study Report (Tanigahara Water Treatment Plant)

Water treatment process

Pictures

● Intake point



● Sedimentation basin (slow filtration system)



● Coagulation/sedimentation basin (rapid filtration system - horizontal)



● Coagulation/sedimentation basin (rapid filtration system)



● Slow filtration basin



● Rapid filtration basin



Other facilities:

● Backup Power Supply System

In the event of a blackout cuts the commercial power supply, a backup power generator enables the operation for up to one fourth of the total plant capacity.



Other information

- The Brochure of the Tanigahara Water Treatment Plant (March 201)
- The Water Quality of the Kanawaga Prefectural Government's Water Supply Service (Jan 2016)

Case Study Report (Oyama Water Treatment Plant)

W a t e r t r e a t m e n t p l a n t	Case #2-3	Oyama Water Treatment Plant
	Key word:	Membrane filtration, surface water (river)
	Outline:	<p><Characteristics></p> <ul style="list-style-type: none"> • Demand fluctuation management: Situated in a tourist zone, the Oyama Water Treatment Plant has relatively broad water demand fluctuations throughout the year but has been producing drinking water in a safe and reliable manner. <p><Outline></p> <ul style="list-style-type: none"> • With a capacity of 740 m³/d, it abstracts water from the Oyama River and supplies about 270 households in the Oyama and Koyasu Districts. • Service area: portions of 1 City
	Address:	Sakamoto 671, Oyama, Isehara City, Kanagawa Prefecture
	Land area:	592m ²
	Treatment process:	Sedimentation + Membrane filtration + Chlorine disinfection
	Capacity	1,000 m ³ /d
	Water source:	Surface water (Oyama River)
	Raw water quality:	<p>■ Abstracted from a mountaineous region, the raw water has a high quality with little artificial contaminations.</p> <p><Average raw water quality in FY2014 (maximum)></p> <ul style="list-style-type: none"> • Turbidity: 0.6 degrees (2.3 degrees) • Hardness: 36 mg/L (38 mg/L) • TOC: 0.5 mg/L (1.7 mg/L) • pH: 7.6 (7.7) • Color: 2.1 degrees (6.4 degrees) • Geosmin: <0.001µg/L (-) • 2-MIB: <0.001 µg/L (-) • TON: 3 (5)
	Chemical dose:	Sodium hypochlorite (disinfection)
	Start of operation:	April 1986 (membrane filtration since 1998)

Case Study Report (Oyama Water Treatment Plant)


● Outside appearance

Layout



Water treatment process

Treatment process flow diagram:

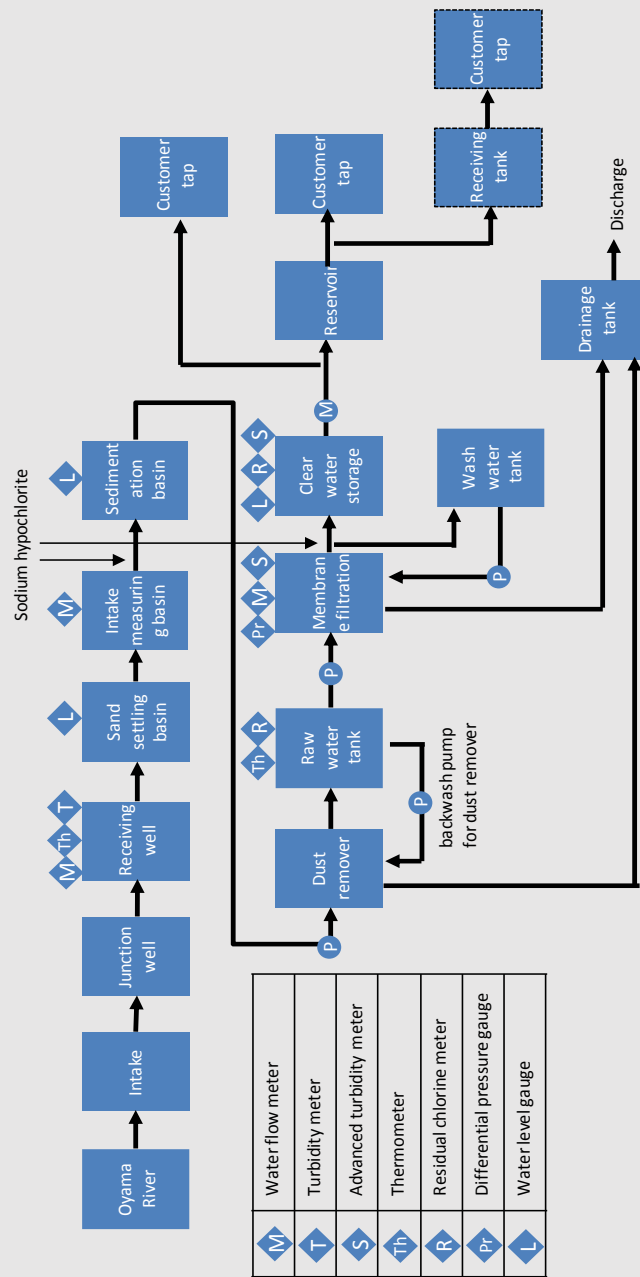







Case Study Report (Oyama Water Treatment Plant)

W
a
t
e
r

t
r
e
a
t
m
e
n
t

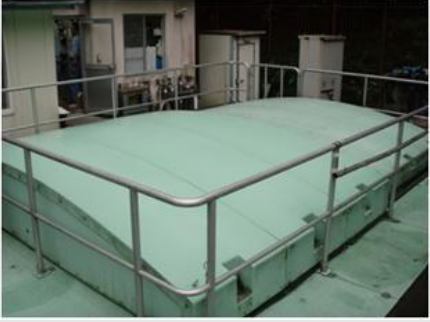p
l
a
n
t

Pictures	<p>● Intake point</p> 	<p>● Intake point</p> 	
	<p>● Settling basin, Sedimentation basin (when covered)</p> 	<p>● Settling basin, Sedimentation basin (when opened)</p> 	
	<p>● Membrane filtration system</p> 	<p>● Membrane filtration system</p> 	
	<p>Other facilities:</p>	<p>● Membrane module 12 m³ x 34 modules x 3 trains (102 modules in total) Filtration method: external pressure type dead-end filtration Filtration velocity: 1.0 m³/m²*d (maximum) Module size: φ114×1,078 mm</p>	
	<p>Other information</p>		
	<ul style="list-style-type: none"> • The Brochure of the Oyama Water Treatment Plant (June 2010) • The Water Quality Report of the Kanawaga Prefectural Government's Water Supply Service (Jan 2016) 		

Case Study Report (Midono Water Source)

W
a
t
e
r

t
r
e
a
t
m
e
n
t

p
r
o
c
e
s
s

Case #2-4	Midono Water Source
Key word:	UV treatment system, Spring water
Outline:	<p><Characteristics></p> <ul style="list-style-type: none"> • Environmental measures: Because of a very high raw water quality throughout the year, a UV treatment system has been adopted, saving energy required for water treatment. • Service area: portions of 1 Town • Design capacity: 12,800 m³/d
Address:	Sengokuhara Daigatake 1277-2, Hakone Town, Kanagawa Prefecture (location of the UV treatment system)
Land area:	16,127m ²
Water treatment process:	UV treatment + Chlorine disinfection
Capacity:	12,800 m ³ /d
Water source:	Spring water
Raw water quality:	<p>■ Although influenced by volcanic soil, the raw water has a very high quality with little contaminations.</p> <p><Average raw water quality in FY2014 (maximum)></p> <ul style="list-style-type: none"> • Turbidity: <0.1 degrees (<0.1 degrees) • Hardness: 110 mg/L (110 mg/L) • TOC: <0.1 mg/L (0.1 mg/L) • p H: 7.2 (7.2) • Geosmin: <0.001µg/L (-) • 2-MIB: <0.001 µg/L (-) • TON: <1 (<1)
Chemical dose:	Sodium hypochlorite (disinfection)
Start of operation:	Mar-68

Case Study Report (Midono Water Source)

W
a
t
e
r

t
r
e
a
t
m
e
n
t


p
r
o
c
e
s
s

● Midono Water Source

Layout



Treatment process flow diagram:

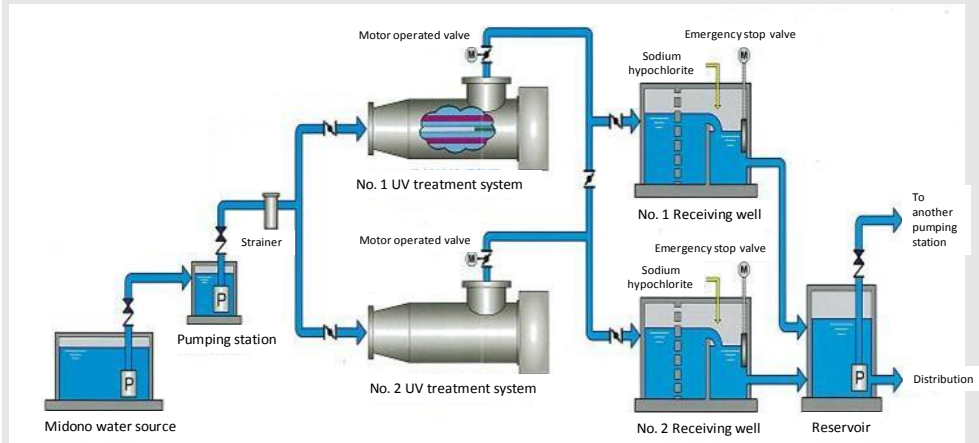

Case Study Report (Midono Water Source)

Water treatment process

Pictures:

● Intake facility



● Spring water
(inside the intake facility)



● UV system




● Intake facility



● UV system (outside)



● UV system structure

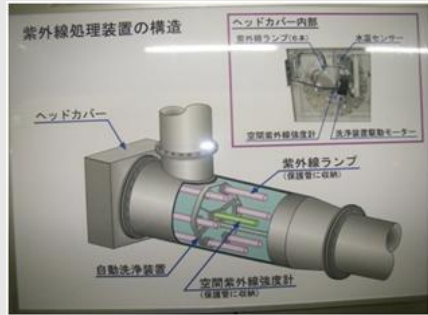

Other facilities:

- UV treatment system
- Irradiation dose: over 10mJ/cm²
- Size of irradiation tank: φ500 mm x 2400 mm
- Number of UV lamps: 6 lamps/unit
- Size of a UV lamp: φ19 mm x 1500 mm

Other information

- ・The Brochure of the Kanagawa Prefectural Government's Water Service in the Hakone Town (Apr 2014)
- ・The Water Quality Report of the Kanagawa Prefectural Government's Water Supply Service (Jan 2016)

Case Study Report (Kissawa Water Source)

W a t e r t r e a t m e n t p r o c e s s	Case #2-5 Kissawa Water Source	
	Key word:	Ground water, Chlorine disinfection only
	Outline:	<p><Characteristics></p> <ul style="list-style-type: none"> • Safe and refreshing drinking water: the ground water has a very good quality throughout the year. <p><Outline></p> <ul style="list-style-type: none"> • Service area: the ground water is used to supplement reservoirs of other water treatment plants. • Maximum capacity: 1,100 m³/d <ul style="list-style-type: none"> 1st well: φ75×60m 2nd well: φ125 x 12 m、φ100 x 48 m
	Address:	Tsuchiya 1760, Hiratsuka City, Kanagawa Prefecture
	Land area:	322m ²
	Water treatment process:	Chlorine disinfection
	Capacity:	1,100 m ³ /d
	Water source:	Ground water
	Raw water quality:	<ul style="list-style-type: none"> ■ The raw water has a very high quality with little contaminants. <p><Average raw water quality in FY2014 (maximum)></p> <ul style="list-style-type: none"> • Turbidity: <0.1 degrees (<0.1 degrees) · Hardness: 140 mg/L (140 mg/L) · TOC: 0.2 mg/L (0.3 mg/L) • pH: 7.6 (7.9) · Geosmin: <0.001μg/L (-) • 2-MIB: <0.001 μg/L (-)
	Chemical dose:	Sodium hypochlorite (disinfection)
Start of operation:	Unknown	

Case Study Report (Kissawa Water Source)

W
a
t
e
r

t
r
e
a
t
m
e
n
t


p
r
o
c
e
s
s

● Overview

Layout:



Treatment process flow diagram:

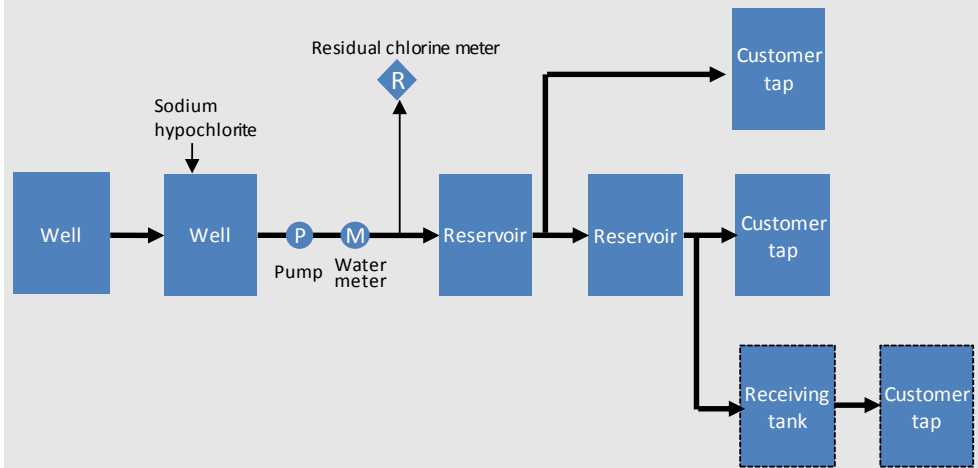

Case Study Report (Kissawa Water Source)

Water treatment process

Pictures

● Well (outside)



● Well (inside)



● Intake facility



● Pumping facility



Other facilities:

—

Other information:

·The Water Quality Report of the Kanawaga Prefectural Government's Water Supply Service (Jan 2016)